


AC00B 4X4 6146 LV Voltage Divider for Clark

***Note: Filaments should be on 1 Min. before B+ is Applied.**

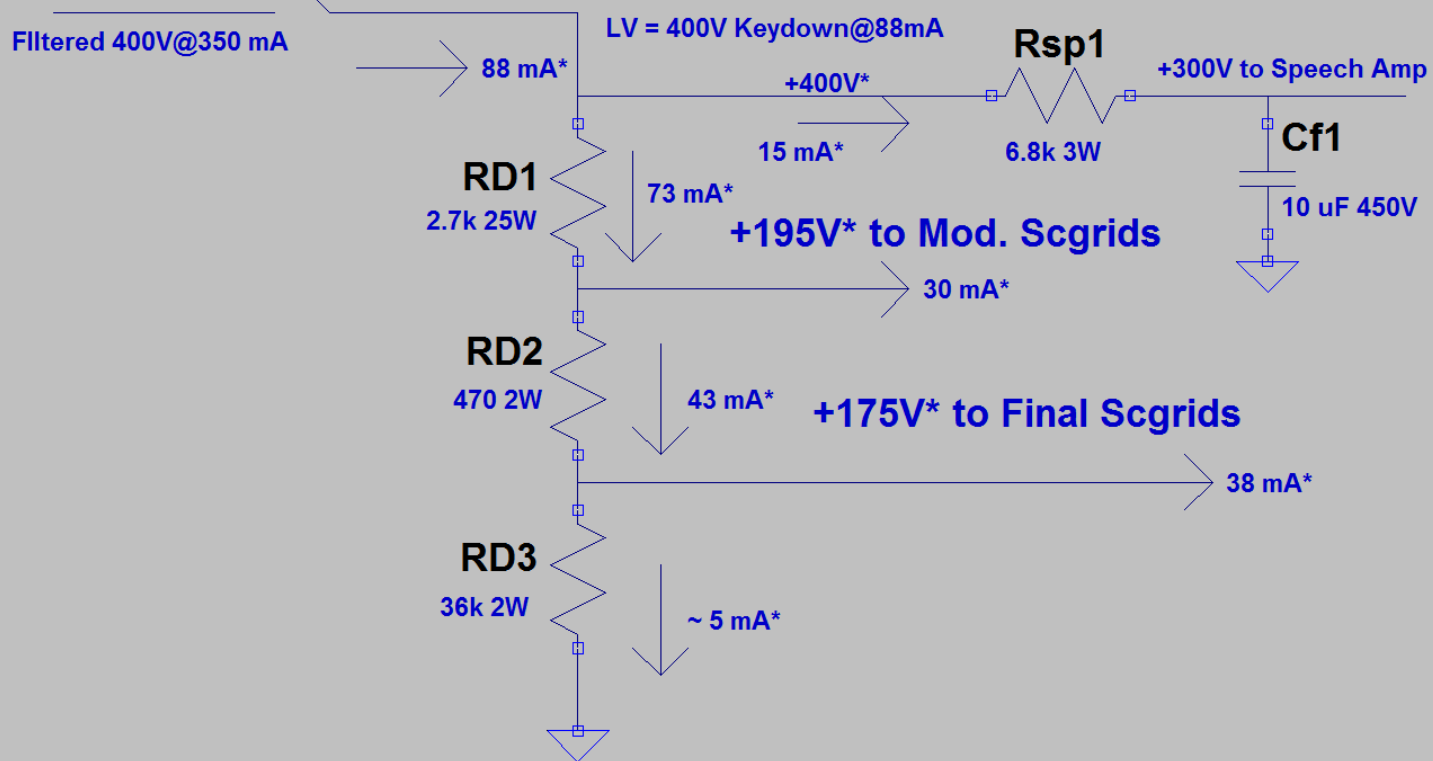

AC00B 4X4 6146 LV Power Supply for Clark

***Note: Filaments should be on 1 Min. before KeyDown.**

<https://www.edcorusa.com/cxc125-10h-200ma>

